


Steps to Manually
WASH, RINSE and SANITIZE
 Equipment and Utensils

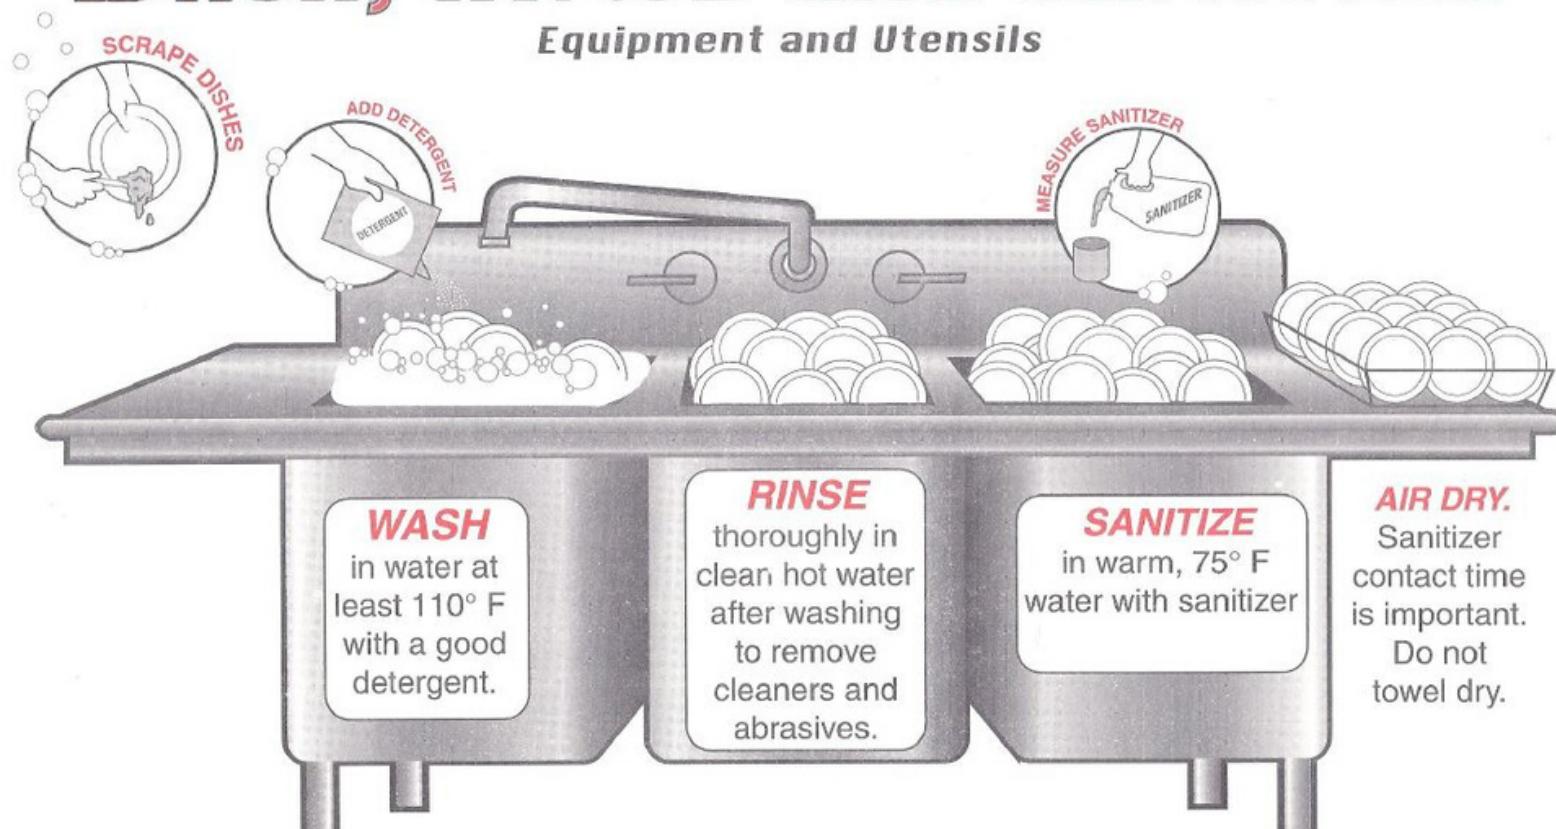

Concentration Range (MG/L)	Minimum Temperature PH 10 or less °C (°F)	Minimum Temperature PH 8 or less °C (°F)
25 – 49	49 (120)	49 (120)
50 – 99	38 (100)	24 (75)
100	13 (55)	13 (55)

REMEMBER- EQUIPMENT AND UTENSILS CANNOT BE SANITIZED UNLESS PROPERLY CLEANED FIRST.

Sanitize by completely immersing utensils and equipment in 3rd compartment chlorine sanitizing solution for time (7-10 seconds) noted in the table above. For quaternary ammonium sanitizers, use according to the directions on the container and immerse for 30 seconds with a minimum water temperature of 75° F. The pH, temperature, and hardness of the rinse water may affect the concentration and contact time required for the sanitizer.

DO NOT TOWEL DRY-AIR DRY; Sanitizer contact time is important.



Woodford County
Health Department

Public Health
Prevent. Promote. Protect.

1831 S Main St, Eureka, Illinois
health.woodfordcountyil.gov wchd 02/2024